
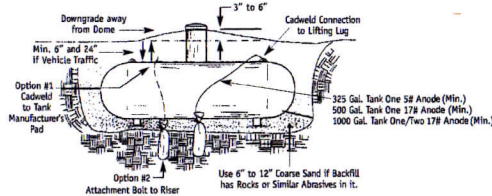



## Guidelines for Underground Tank Installation

| Tank Size    | Underground Tank Dimensions | Approximate Excavation Dimensions (generally allow 12" on each side) |
|--------------|-----------------------------|--|
| 1000 Gallons | 16'8" x 3'4"                | 18'0" x 5'6"   |
| 500 Gallons  | 10'0" x 3'1"                | 12'0" x 5'0"   |
| 325 Gallons  | 10'0" x 2'5"                | 12'0" x 4'6"   |
| 120 Gallons  | 5'6" x 2'0"                 | 7'0" x 4'0"  |

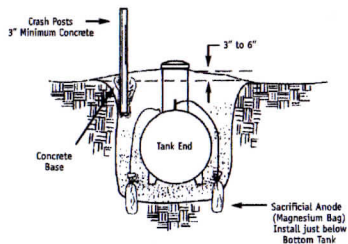

## Guidelines for Underground and Aboveground Tank Installation

Federal, state and local ordinances and regulations should be observed at all times.

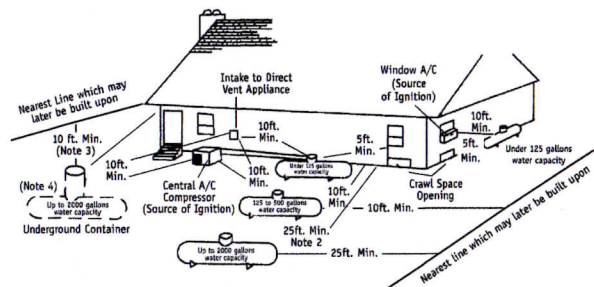


### NOTES:

- Regardless of its size, any ASME tank filled on site must be located so that the filling connection and fixed liquid level gauge are at least 10 feet from external source of ignition (e.g. open flame, window A/C, compressor, etc.), intake to direct vented gas appliance or intake to a mechanical ventilation system.
- May be reduced to 10 feet minimum for a single container of 1200 gallons water capacity or less if it is located at least 25 feet from any other LP-Gas container of more than 125 gallons water capacity.
- Minimum distances from underground containers shall be measured from the relief valve and filling or level gauge vent connection at the container, except that no part of an underground container shall be less than 10 feet from a building or line of adjoining property which may be built upon.
- Where the container may be subject to abrasive action or physical damage due to vehicular traffic or other causes, it must be either:
  - placed not less than 2 feet below grade;
  - otherwise protected against such physical damage.

## Guidelines for Aboveground Cylinder Installation

Federal, state and local ordinances and regulations should be observed at all times.

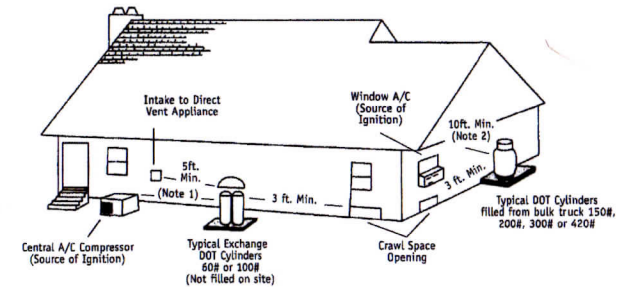

### NOTES:

- For exchange cylinders, 5 foot minimum between relief valve discharge and external source of ignition (e.g. air conditioner), direct vent or mechanical ventilation system (e.g. attic fan).
- If the DOT cylinder is filled on site from a bulk truck, the filling connection and vent valve must be at least 10 feet from any external source of ignition, direct vent or mechanical ventilation system.